


TYBOX 417

www.deltadore.com


Important product information (4)

	2 x 1,5V LR03 - AAA Alkaline
Class	
S1	2 A max., 230V~ (Type 1.C)
S2	
°C	-5°C / +40°C
	80 x 103 x 25 mm
IP	IP 30
CE	2004/108/CE - 2006/95/CE

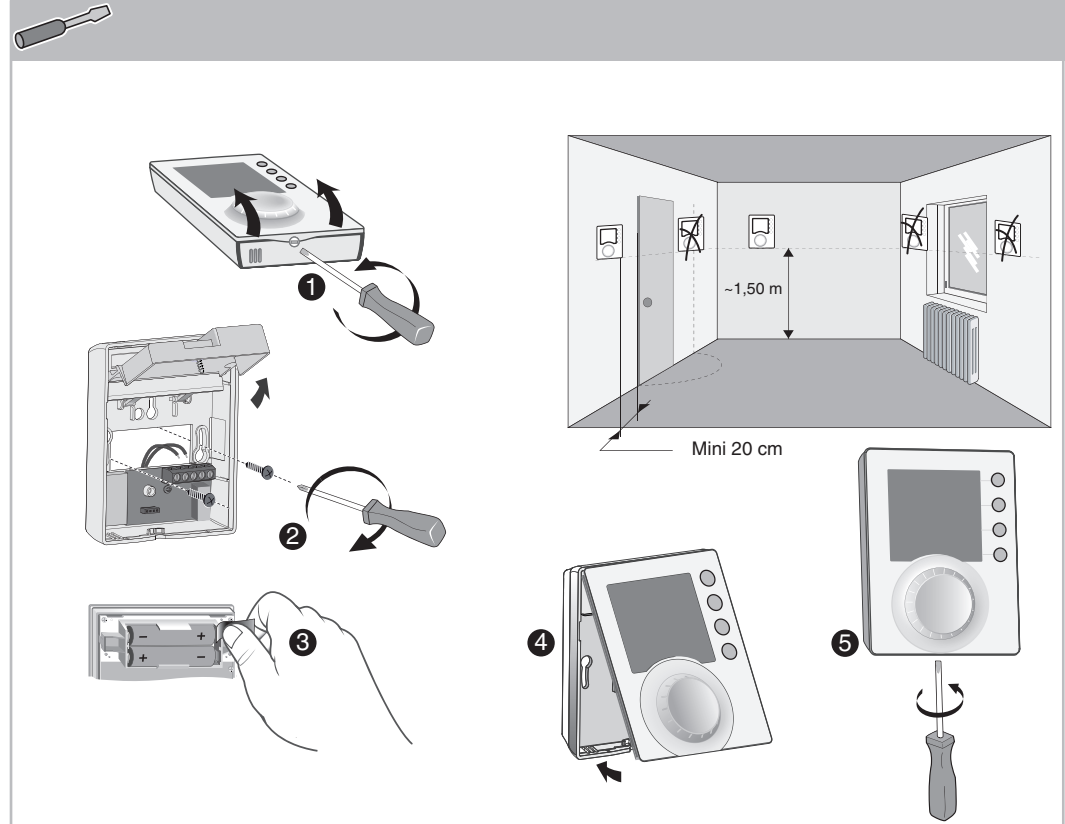


1
S1 = None
S2 = Th



Th Entrée thermostat / Thermostat input /
Entrada termostato / Entrada do termostato /
Ingresso termostato / Thermostat-eingang /
Wejście dla termostatu / Thermostaatingang /
Termostat vstupní / Termostat ingång /
Termostat input / Termostat inngang /
Termostaatti tulo / 温控器输入

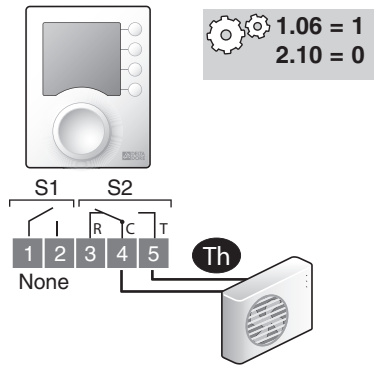

2
S1 = Change-over
S2 = Th

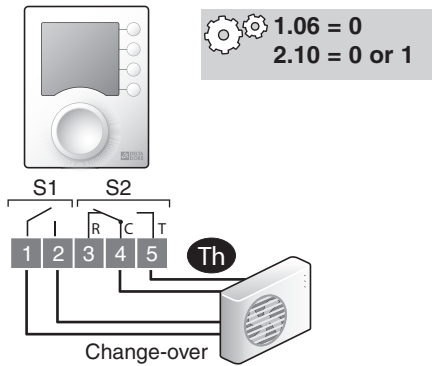


3
S1 = Th Cool
S2 = Th Heat

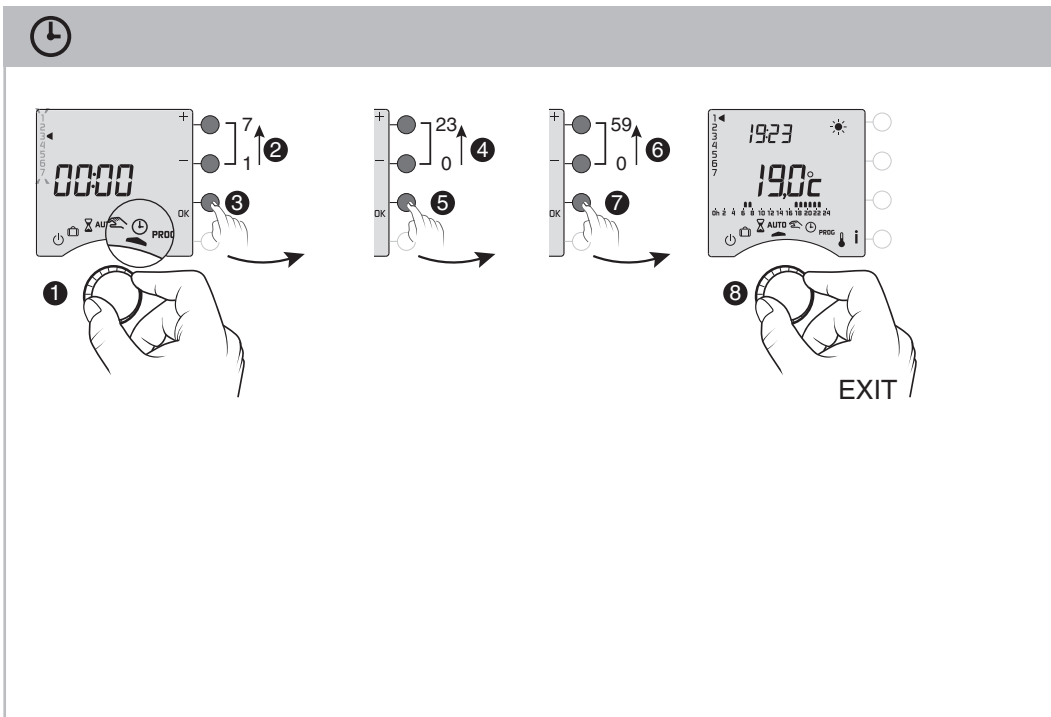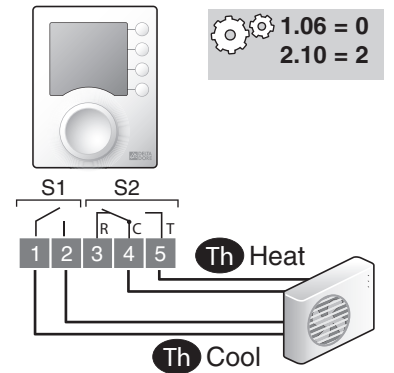



MENU 1

1-01	PROG 7 / PROG 1
1-02	Prog 60', 30', 15' 0h 2
1-06	HEAT / HEAT-COOL
1-08	Confort régulé par TYBOX / Comfort regulated by TYBOX / Confort regulado por TYBOX / Modo Conforto regulado por TYBOX / Comfort regolato mediante TYBOX / Komforteinstellung über den TYBOX / Regulacja komfortu przez TYBOX / Comfort geregeld door TYBOX / Komfort regulovaný TYBOX / Komfort reglerad av TYBOX / Komfort reguleret af TYBOX / Komfort reguleret av TYBOX / Lämpötilan sää-tely TYBOXilla / 通过TYBOX调节的舒适状态
1-09	Anti-grippage / Anti-seizing / Antigripado / Antigrippagem / Antigrippaggio / Festlaufschutz / System zapobiegający blokowaniu się pompy / Antiblokkering / Proti zadření / Anti-friktion / Anti-rivning / Antiblokkering / Kiertovesipumpun kiinnijuuuttumisen esto / 防卡

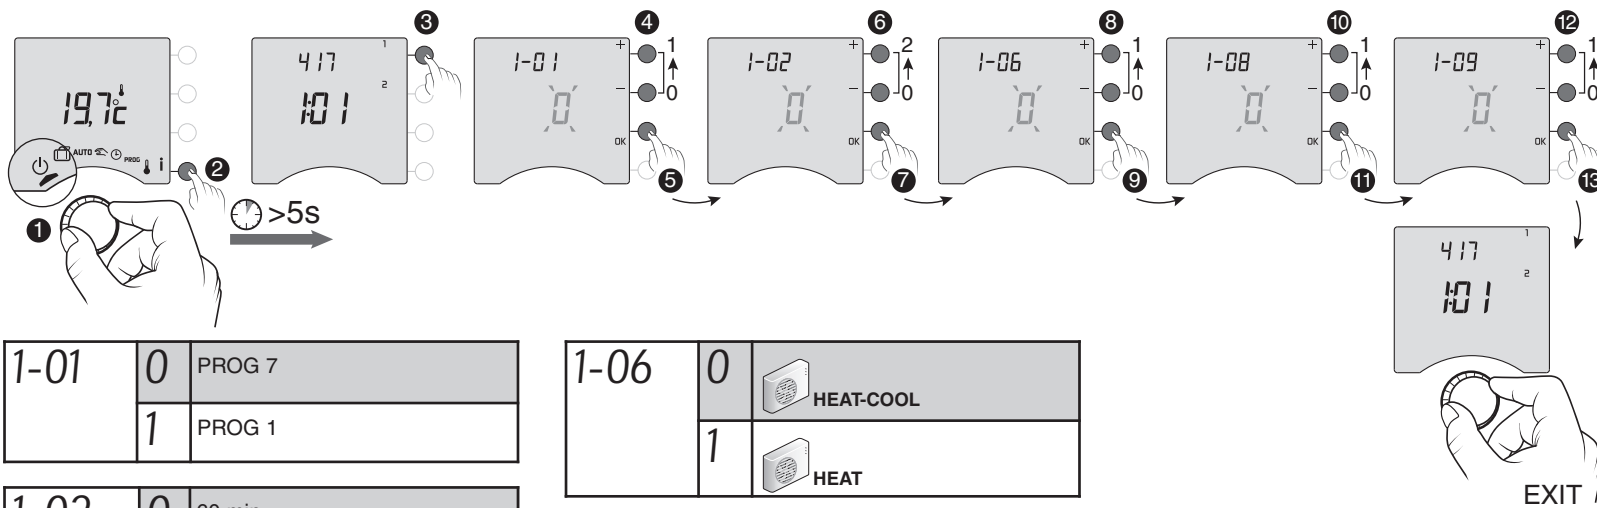

1-01	0	PROG 7
	1	PROG 1

1-06	0	HEAT-COOL
	1	HEAT

1-02	0	60 min.
	1	30 min.
	2	15 min.


1-08	0	Yes
	1	No

1-09	0	No
	1	Yes



MENU 2

2-01	Limitation consignes / Settings limitation / Limitación consignas / Limitação de recomendações / Limitazione valori di riferimento / Begrenzung der Sollwerte / Ograniczenie wartości zadane / Beperking ingestelde temperatuur / Omezení - pokyny / Anvisningsbegränsningar / Begrænsning indstillingsværdier / Begrensning i instruksene / Ohjearvojen rajoitus / 温度设定限制
2-02	Correction température mesurée / Measured temperature correction / Corrección temperatura medida / Correção da temperatura medida / Correzione temperatura misurata / Korrektur der gemessenen Temperatur / Korekta zmierzzonej temperatury / Aanpassen gemeten temperatuur / Korekce měřené teploty / Uppmätt temperaturkorrigering / Korrekturion målt temperatur / Korreksjon av målt temperatur / Mitatun lämpötilan korjaus / 测量出的温度的校正
2-04	Affichage mode AUTO / AUTO mode display / Visualización modo AUTO / Visualização em modo AUTO / Visualizzazione modalità Auto / Anzeige AUTO-Modus / Wyświetlanie tryb AUTO / Weergave AUTO-modus / Zobrazení režimu AUTO / Visning av AUTO-läge / Visning AUTO funktion / Display for AUTO-modus / AUTO-tilan näyttö / 自动模式显示

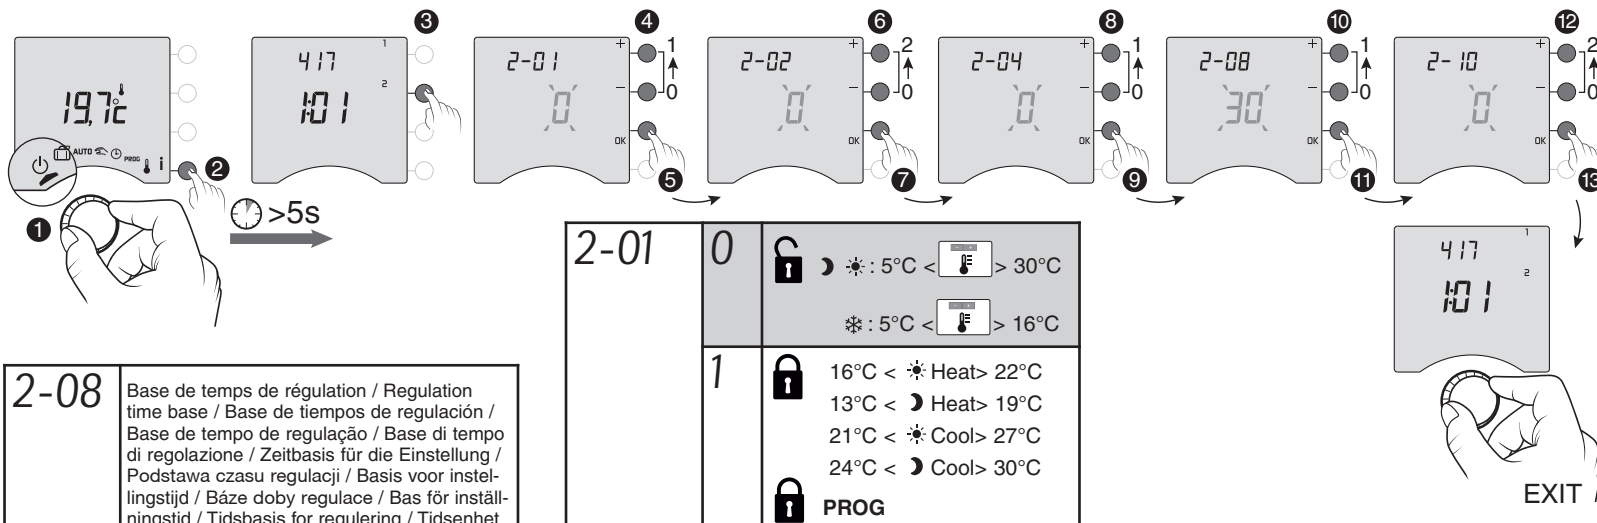

2-08	Base de temps de régulation / Regulation time base / Base de tiempos de regulación / Base de tempo de regulação / Base di tempo di regolazione / Zeitbasis für die Einstellung / Podstawa czasu regulacji / Basis voor instellingstijd / Baze doby regulace / Bas för inställningstid / Tidsbasis for regulering / Tidsenhet for regulering / Lämmönsäätelyn aikayksikkö / 调节时基
------	---


2-01	0	🔒 ☀️ : 5°C < > 30°C ☀️ : 5°C < > 16°C
	1	🔒 16°C < ☀️ Heat > 22°C 13°C < ☾ Heat > 19°C 21°C < ☀️ Cool > 27°C 24°C < ☾ Cool > 30°C
	🔒	PROG

2-10	S1 / S2
------	----------

2-02	- 5°C < > +5°C
------	-----------------

2-04	0	
	1	

2-10	0	• S1 (Change-over) = Heat ; = Cool • S2 (Th)
	1	• S1 (Change-over) = Cool ; = Heat • S2 (Th)
	2	• S1 (Th Cool) • S2 (Th Heat)

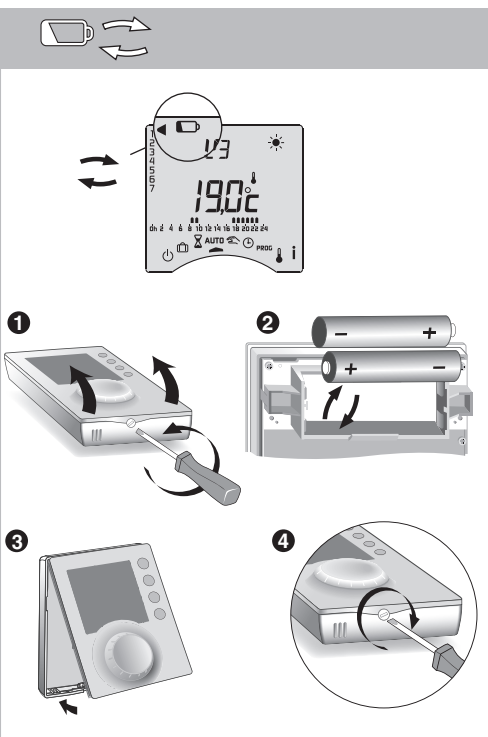

RESET

